

specifications

The medical gas retro-fit outlet shall be an Amico Alert-1 series.

Outlets shall be equipped with a primary and secondary check for positive pressure for gas services. The secondary check valve shall be rated at a maximum of 200 psi [1,379 kPa] in the event the primary check valve is removed for maintenance. Outlet bodies shall be gas specific by indexing each gas service to a gas specific dual pin indexing arrangement on the respective identification module.

A large color coded front plate shall be used for ease of gas identification and aesthetic appeal.

A one piece surface mount box shall cover the outlet.

The latch-valve assembly shall be DISS (Diameter Index Safety System) compatible and accept only corresponding DISS type gas specific adapters or any of the compatible outlets manufactured by Amico.


Amico products comply with NFPA-99.



features

- ▶ Flow rate exceeds the requirements of NFPA and CSA
- ▶ Accepts DISS, Ohmeda Diamond™, and Puritan Bennett gas specific adapters depending on the type ordered
- ▶ Each outlet is 100 % Hydrostatically tested and cleaned for medical gas service
- ▶ Indexed to eliminate interchangeability of gas services
- ▶ Universal rough-in assembly to accept Quick Disconnect or DISS front adapters (Can be interchanged at any time)

project

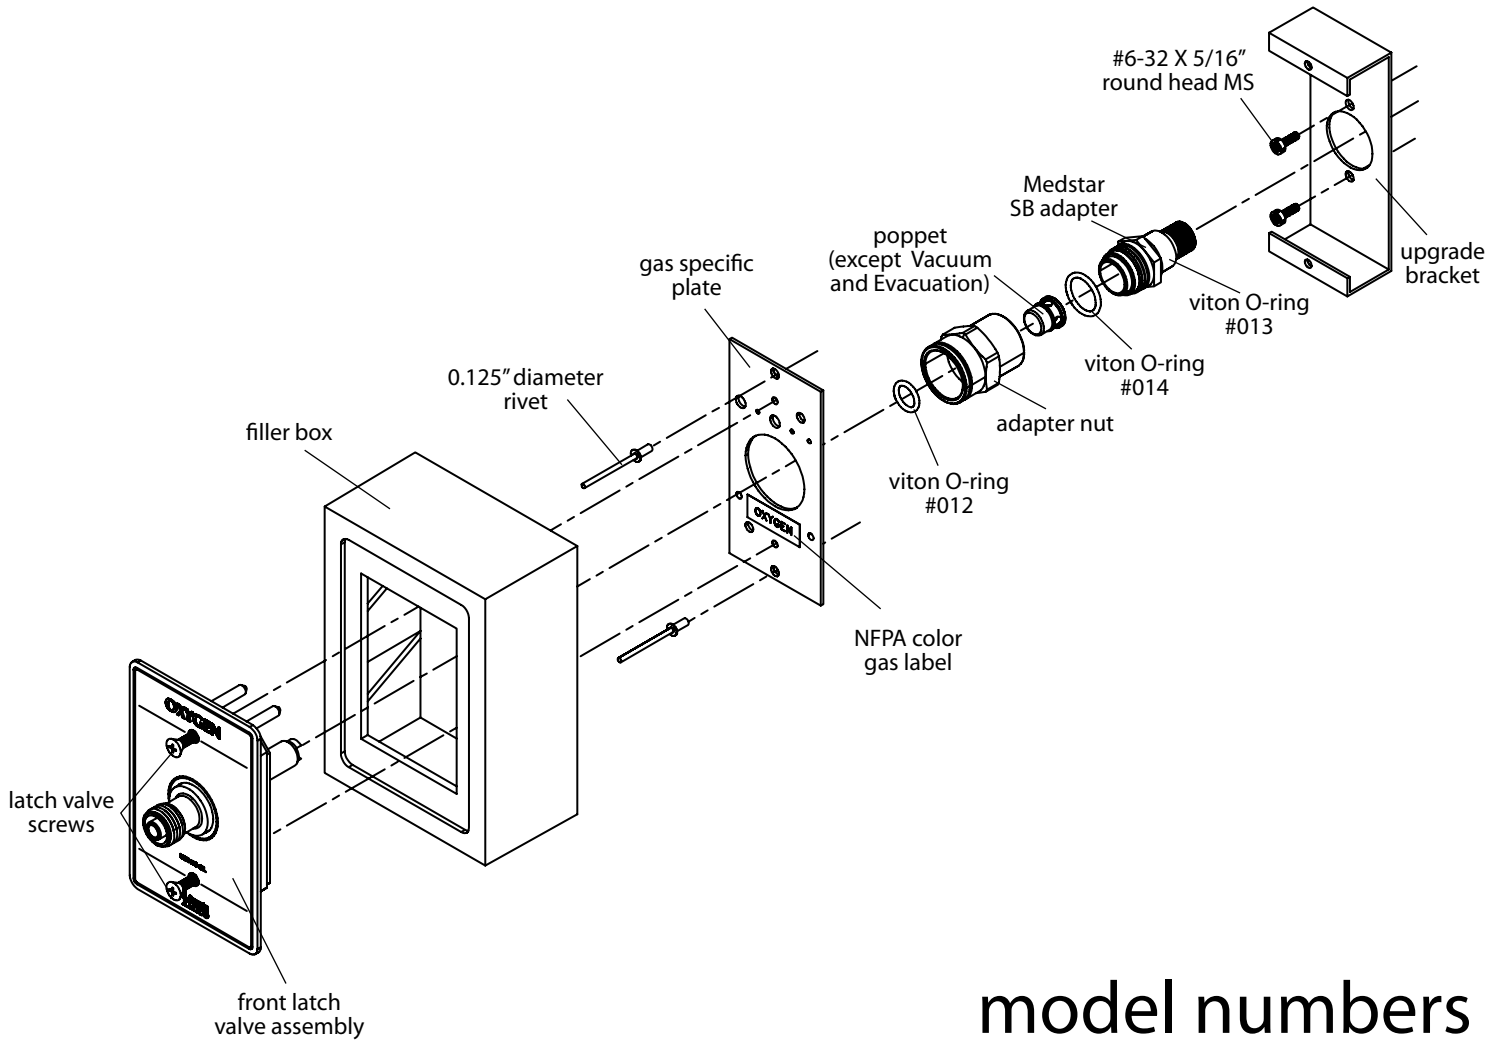

model numbers

O-OXSB-XX-L-XXX

Connection Type:

- DI = DISS (Diameter Index Safety System)
- PB = Puritan Bennett (Quick Connect)
- QD = Ohmeda (Quick Connect)

The L defines the language:

- U = English (NFPA)
Oxygen, Medical Air, Medical Vacuum, and Waste Anesthetic Gas Disposal only
- E = English (CSA/ISO)
- F = French (CSA/ISO)

The XXX defines the gas:

- OXY = Oxygen
- AIR = Medical Air
- VAC = MedVac
- N2O = Nitrous Oxide
- NIT = Nitrogen*
- CO2 = Carbon Dioxide**
- WAG = Waste Anesthetic Gas Disposal (NFPA)
- AGS = Anesthetic Gas Scavenging System (CSA)

* Available in DISS connection type only

** Available in Ohmeda and DISS connection types only

represented by: